



TRANSMISSION SYSTEM ENERGY BALANCE MONTHLY
REPORT

Info :A. Grassou +30 210 9466905

	AUGUST 2008	COMPARED TO LAST YEAR(%)	JANUARY - AUGUST 2008	COMPARED TO LAST YEAR(%)
PRODUCTION AND EXCHANGE BALANCE (MWh)				
TOTAL PRODUCTION & EXCHANGE BALANCE	5.395.255	3,01	38.775.367	1,41
TOTAL NET PRODUCTION	4.781.301	1,33	34.746.361	-0,51
CLASSIFICATION				
LIGNITE	2.802.025	-4,43	19.588.615	-6,53
OIL	282.269	-4,30	2.232.567	5,44
NATURAL GAS	1.240.467	15,25	9.727.856	11,46
HYDRO	285.270	-7,34	2.186.030	-3,68
*RENEWABLE AND OTHER SOURCES	171.270	59,28	1.011.293	18,72
EXCHANGE BALANCE	613.954	18,32	4.029.006	21,63
IMPORTS	740.611		5.232.742	
from TURKEY	0		0	
from ALBANIA	0		393	
from FYROM	104.640		785.725	
from BULGARIA	485.751		3.204.009	
from ITALY	150.220		1.242.615	
EXPORTS	126.657		1.203.736	
to TURKEY	0		29.791	
to ALBANIA	113.921		1.019.646	
to FYROM	2.218		46.267	
to BULGARIA	0		0	
to ITALY	10.518		108.032	

CONSUMPTION (MWh)					
TOTAL CONSUMPTION	5.395.255	3,01	38.775.367	1,41	
NET CONSUMPTION	5.300.424	2,89	37.995.924	1,37	
PUMPING	94.831		779.443		
CLASSIFICATION					
CONSUMPTION OF ELECTRICITY SECTOR	10.666		102.997		
HV INDUSTRIAL CUSTOMERS	589.964	3,89	5.135.767	-0,79	
DISTRIBUTION NETWORK	4.489.812	3,07	31.265.688	1,96	
** AUTOPRODUCERS	0		0		
PUMPING	94.831		779.443		
MINES	85.174	-3,54	635.514	-12,60	
SYSTEM LOSSES	124.808		855.958		
SYSTEM POWER (MW)					
SYSTEM INSTANT PEAK LOAD	9.764	***	10.393	***	
date / time of peak load	26/08/08	14:00	22/07/08	15:00	
Athens (ROUF) temperature at peak time (°C)	38		38		
HOURLY AVERAGE LOAD IN ATTIKI	3055		3252		

NOTE:

- * Includes only the HV substations
- ** They are included in the HV INDUSTRIAL CUSTOMERS
- *** Value from SCADA SYSTEM




HELLENIC TRANSMISSION
SYSTEM OPERATOR

TOTAL ELECTRICITY CONSUMPTION
(MWH)
Month : **AUGUST 2008**

TOTAL ELECTRICITY CONSUMPTION	MONTHLY TOTALS	(%)
CLASSIFICATION	5.395.255	100,00
1. ELECTRICITY SECTOR	10.666	0,20
2. HV INDUSTRIAL CUSTOMERS	589.964	10,93
3. DISTRIBUTION NETWORK	4.489.812	83,22
4. AUTOPRODUCERS	0	0,00
5. PUMPING	94.831	1,76
6. MINES	85.174	1,58
7. SYSTEM LOSSES	124.808	2,31

MONTHLY ELECTRICITY CONSUMPTION

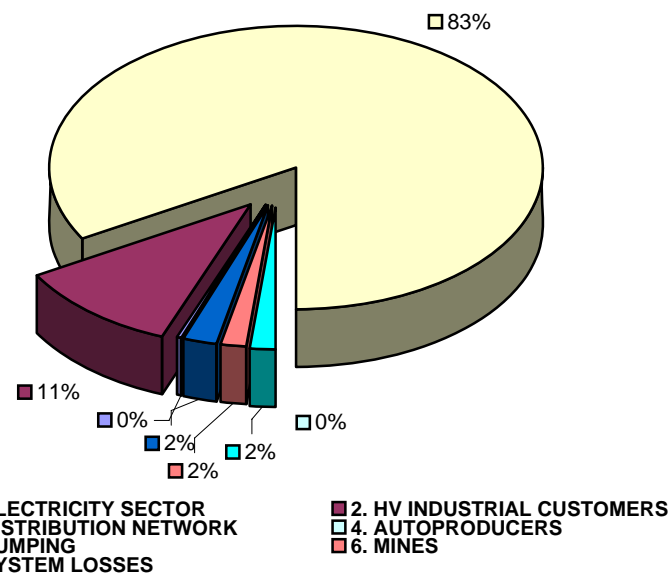




MONTHLY ELECTRICITY PRODUCTION & EXCHANGE BALANCE
(MWH)

Month : AUGUST 2008

TOTAL PRODUCTION & INTERCONNECTIONS	MONTH TOTALS	(%)
TOT.PROD. & INTERCON.	5.395.255	100,00
1. LIGNITE	2.802.025	51,93
2. OIL	282.269	5,23
3. NATURAL GAS	1.240.467	22,99
4. HYDRO	285.270	5,29
5. RENEWABLE	171.270	3,17
6. EXCHANGE BALANCE	613.954	11,38

MONTHLY ELECTRICITY PRODUCTION

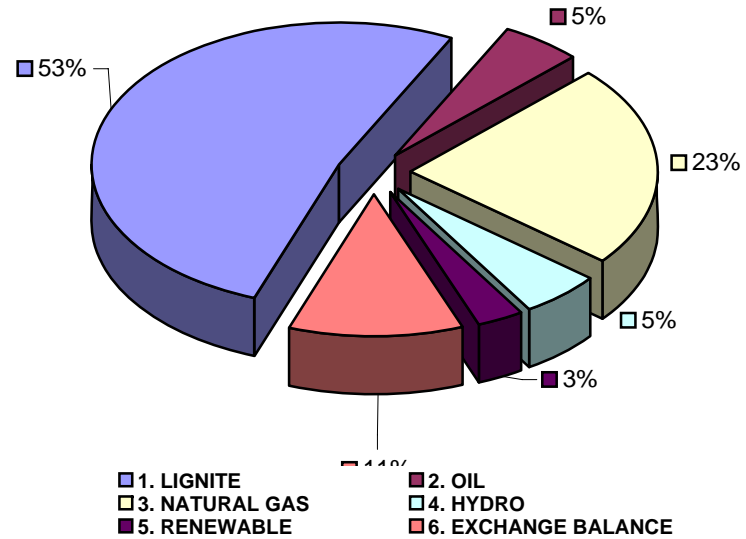



MONTHLY PEAK LOAD ANALYSIS


DAY : 20080826

Hourly average peak load			
MW	9595	Hour	14,00

ELECTRICITY CONSUMPTION DURING PEAK LOAD			
	TOTAL	9595	100,00
1. ELECTRICITY SECTOR	6	0,06	
2. HV INDUSTRIAL CUSTOMERS	704	7,34	
3. DISTRIBUTION NETWORK	8533	88,93	
4. AUTOPRODUCERS	0	0,00	
5. PUMPING	0	0,00	
6. MINES	107	1,12	
7. SYSTEM LOSSES	245	2,55	


ELECTRICITY PRODUCTION DURING PEAK LOAD			
	TOTAL	9595	100,00
1. LIGNITE	4175	43,51	
2. OIL	624	6,50	
3. NATURAL GAS	2307	24,04	
4. HYDRO	1079	11,25	
5. RENEWABLE	159	1,66	
6. OTHER SOURCES	1	0,01	
7. EXCHANGE BALANCE	1250	13,03	

Electricity consumption during peak load

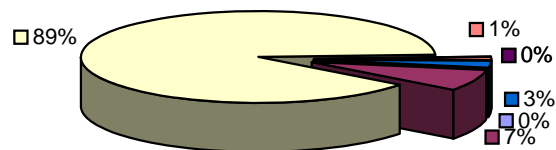

- 1. ELECTRICITY SECTOR
- 2. HV INDUSTRIAL CUSTOMERS
- 3. DISTRIBUTION NETWORK
- 4. AUTOPRODUCERS
- 5. PUMPING
- 6. MINES
- 7. SYSTEM LOSSES

Electricity production during peak load

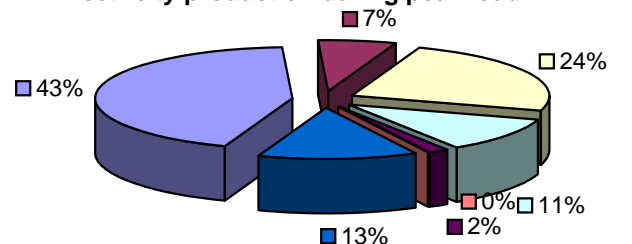

- 1. LIGNITE
- 2. OIL
- 3. NATURAL GAS
- 4. HYDRO
- 5. RENEWABLE
- 6. OTHER SOURCES
- 7. EXCHANGE BALANCE